

Z109S-DI

GALVANIC ISOLATOR FOR CURRENT LOOP WITH HIGH ISOLATION



Isolation 3.500 Vac (3 way)

Lightning impulse withstand voltage 6,5 kV

Input/Output: 0..20, 4..20 mA

Sensor supply 2 wire technique (max 20 mA)

Dimension 100x 112 x 18 mm (l x h x w)

Fast mounting on DIN rail 46277

Enclosure PBT, black color




Made in Italy





Z109S-DI

GALVANIC ISOLATOR FOR CURRENT LOOP WITH HIGH ISOLATION

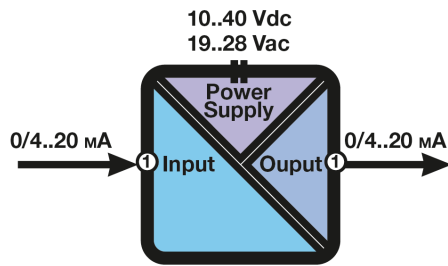

Z109S-DI is a device that allows to isolate and convert a 0/4 - 20 mA signals. The device can power also all 2-wire sensors providing a stabilized voltage of 20 V and a max current of 20 mA with short-circuit protection. A 3-way galvanic isolation of 3.500 Vac among Power supply // input // output circuits assures the integrity of your data.

TECHNICAL SPECIFICATION

GENERAL DATA

Power supply	10..40 Vdc; 19..28 Vac
Power consumption	2,5 W
Power transducers	Active input 2 wire (20 Vdc)
Isolation	3,5 kVac (3 way)
Insulation	Safety insulation < 300 V~ referred to ground CAT II
Input protection:	30 V continuously.
Protection Output / Power supply	Against surge pulses 400 W/ms
Status Indicators	Power
Response time	< 200 μ s
Cutoff frequency	6 kHz
Errors referred to Input's measure range:	Calibration 0,2% - 10 μ A Thermal coeff. 0,02%/K EMI < 1%
Protection degree	IP20
Operating Temperature	-20..+60°C
Weight	200 g
Dimension	100 x 112 x 18 mm
Enclosure	PBT, black color
Connessioni	Removable 3-way screw terminals
Mounting	DIN rail guide 35 mm

INPUT

Channel numbers	1 (active / passive)
Type	Current 0 - 20 mA or 4 - 20 mA, 20 V~ stabilized loop supply, input impedance ~ 50 Ω


OUTPUT

Channel numbers	1 (active / passive)
Type	Current, 0/4..20 mA Max load 600 Ω

STANDARD

Approval	CE
Norms	EN 61010-1 EN 61000-6-2 EN 61000-6-4

APPLICATION NOTE

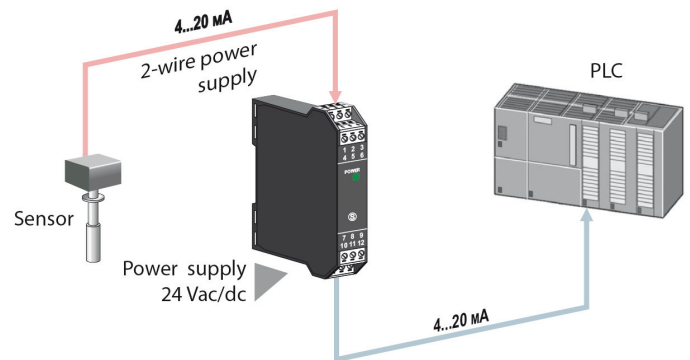

ORDER CODES

Code	Description
Z109S-DI	Galvanic isolator for current loop with high isolation
Z-SUPPLY	Single-phase switching power supply 24V @ 1.5A



Via Austria, 26 • 35127 Padova - (I) - Tel. +39 049 87.05.359
Fax +39 049 87.06.287 • www.seneca.it • info@seneca.it

The material in this document is for information only and is subject to change without notice. While reasonable efforts have been made in the preparation of this document to assure its accuracy, SENECA assumes no liability resulting from errors or omissions, or from the use of the information contained herein.