

Z113-1



DOUBLE ALARM THRESHOLD WITH UNIVERSAL INPUT AND RELAY OUTPUT




- Power Supply 10..40 Vdc, 19..28 Vac
- Transducer power supply
- Isolation 1.500 Vac between Power supply and input , 3.000 Vac in output
- Nr 1 configurable input as mA, V, Ohm, RTD, TC
- Nr 2 thresholds relay SPST, 3 A, 250 Vac
- Configuration through software and Micro USB port (EASY SETUP)



Z113-1

DOUBLE ALARM THRESHOLD WITH UNIVERSAL INPUT AND RELAY OUTPUT

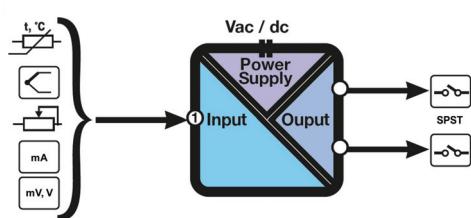

Z113-1 is an alarm threshold with two relay output SPST from 3A 250V with a common contact. The module allows to select the input type via DIP-switch: voltage, current, potentiometer, thermocouple (TC), thermoresistance (RTD). Input, output, input filter, rejection and burn-out can be configured through Software (via front USB port),

Technical Specifications

General Data	
Power supply	10..40 Vdc; 19..28 Vac
Transducer Power	Yes, current input (mx 17 V – 20 mA)
Power consumption	2,5 W
Isolation	1.500 V between input and Power supply (3.000 V output)
Protection Degree	IP20
Status Indicators	Power supply, error, data transmission, data reception, input status
Connections	Terminals Micro USB Front
Settings	Software (EASY SETUP) through USB
Operating Temperature	-10..+65°C
Weight	140 g
Dimension	100 x 112 x 17,5 mm (W x H x D)
Enclosure	PBT, black

Input

Channel Numbers	1
Resolution	14 bit
Sampling time	16,66 ms..20 ms
Filter	0..19
Response time	Sampling time + 6 ms
Accuracy	0,1%
Type	Voltage: 0..10 V (impedance 120 kΩ) Current: 0..20 mA (active/passive connection; internal shunt 50 Ω; power supply from the sensor) Potentiometer: 1 .. 100 kΩ (1 mA excitation current) TC: J,K,R,S,T,B,E,N, autodetection burn-out RTD: Pt100, Pt500, Ni100, Pt1000 (2,3,4 wire)

Output

Channel Numbers	2
Type	Relay SPST 3A, 250 Vac

STANDARD

Approval	CE
Norms	EN 61000-6-4 EN 61000-6-2 EN 61010-1



Via Austria, 26 • 35127 Padova - (I) - Tel. +39 049 87.05.359
Fax +39 049 87.06.287 • www.seneca.it • info@seneca.it



The material in this document is for information only and is subject to change without notice. While reasonable efforts have been made in the preparation of this document to assure its accuracy, SENECA assumes no liability resulting from errors or omissions, or from the use of the information contained herein.